



NOTES:
 DEAERATOR MODULATING FEED WATER VALVE SHIPPED LOOSE.
 DEAERATOR STEAM PRV SHIPPED LOOSE.
 DEAERATOR RELIEF VALVE SHIPPED LOOSE.
 14" BOILER STACKS INSTALLED BY OTHERS.
 DEAERATOR AND STEAM PIPING INSULATION INSTALLED BY OTHERS.

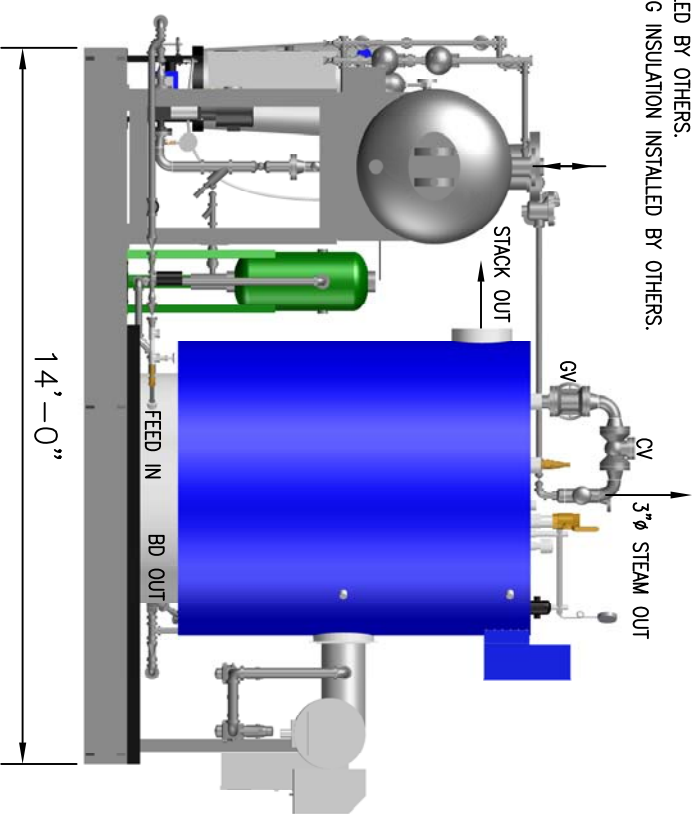

NO.	REVISION	DATE	BY	APR

© COPYRIGHT THIS DRAWING IS THE PROPERTY OF NAMCO DIV. OF JOHN R. NEAL & ASSOCIATES INC. DALLAS, TEXAS ITS USE WITHOUT THE EXPRESS WRITTEN PERMISSION IS PROHIBITED.

ENG. RECORD	DATE
DRAWN BY RDO	04/21/14
CHECKED	
APPROVED	07/28/14
APPROVED	
SCALE NONE	

BHTM-P-70-150	
JOB NO.	N-3171
DRAWING NO.	14-00018
REV.	1